


3Ø Padmount Transformer Concrete Pad

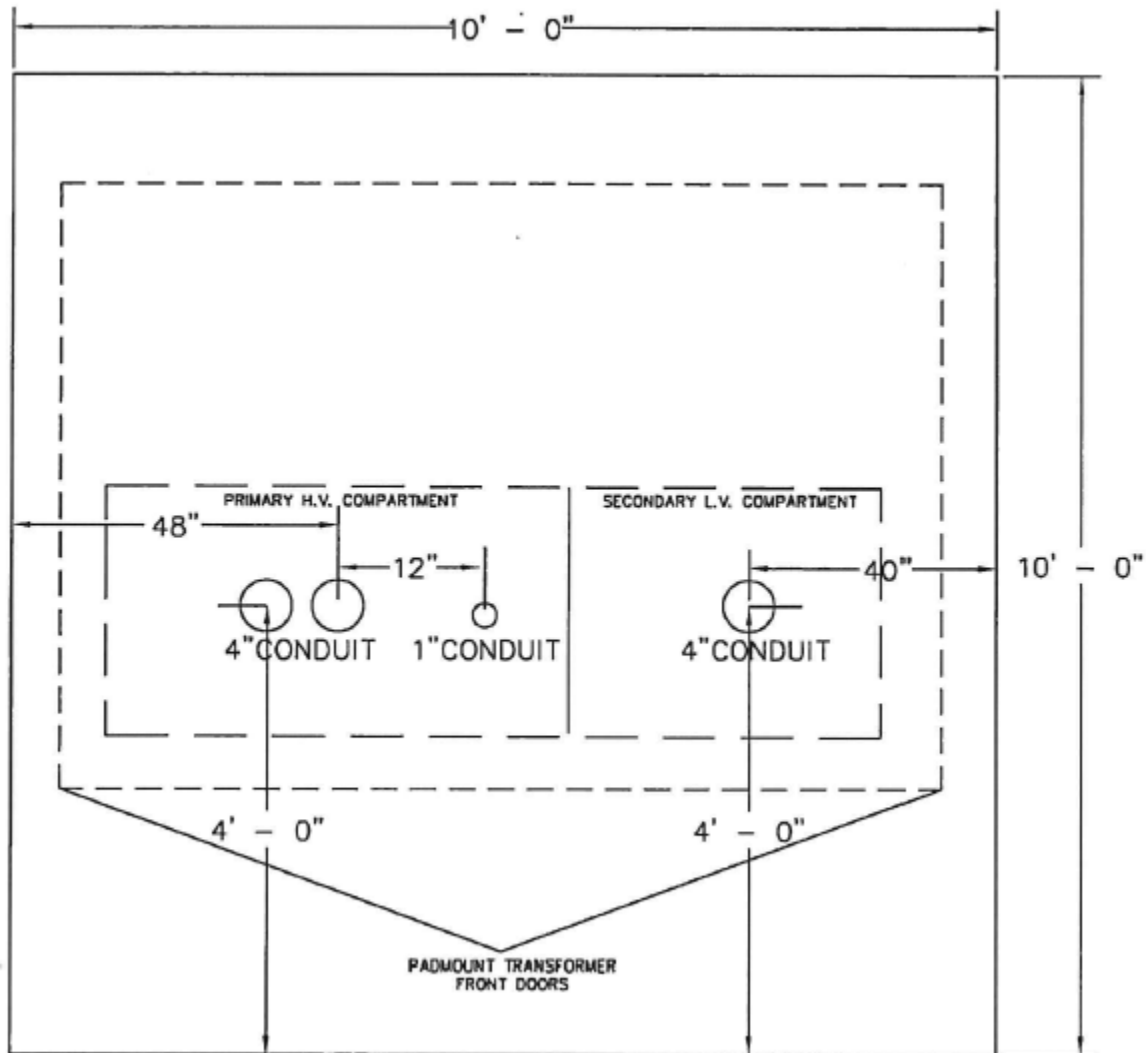

Notes:

1. Concrete pad shall be 8" thick and shall contain a layer of rebar.
2. Concrete mixture shall be a 2500 pound mix.
3. 1" conduit to be used for utility company ground rod.
4. 4" conduit to be used for utility company primary conduit.
5. Contractor shall be responsible for sizing secondary conduit.
6. Center of secondary conduit(s) to be located as noted.
7. Contractor shall notify utility company prior to pouring pad in order to verify conduit stub out locations.